BREAN



The industry's most advanced residential fresh air system, created to offer a universal platform specifically designed and improved to make contractors life easier and more profitable while delivering constant superior air quality.

- Thanks to the Virtuo Air Technology[™], the airflow calibration and auto-balancing are achieved quickly and maintained throughout the life of the product
- Select the desired CFM (from 35 to 160 CFM) using the proven integrated LCD screen
- Integrated electronic airflow measurement device with real time LCD
- Integrated diagnostic tool
- Equipped with PMSM ECM motors for energy efficient operation
- Suspended installation (chains included) OR
- Wall-mount installation (universal brackets included)
 - installation with 2 brackets
 - installation with 4 brackets

Fresh Air Systems - 160 CFM



Top ports: B160H75RT Side ports: B160H75RS

35 to 159 CFM @ 0.2 in. w.g. 35 to 150 CFM @ 0.4 in. w.g.

HRV













Parts/Motor

Visit Broan-NuTone.com for complete warranty text.

Unit Description

- SRE of 77% at 32°F (64 CFM) and 67% at -13°F (66 CFM)
- Ports size: 6"
- Recirculation defrost
- Corrosion resistant galvanized steel door and cabinet
- One-piece molded insulation shell, no air leakage (expanded polystyrene; UL 94 HF-1 certified)
- Virtuo constant airflow and auto-balancing device (patent pending)
- Motorized dampers (no additional backdraft dampers required)
- Integrated "snap-in" drain system installed in seconds with no additional parts (drain hose included)
- Recirculate air within the dwelling with recirculation mode using a main wall control
- 6' power cord
- Unit electrical characteristics: 120 volts, 60 Hz, 2.4 A, 163 W

Controls

AUTOMATIC

TANTO TANTO











BOOST

OVERRIDE

There are 4 optional main controls and 2 optional auxiliary controls available. Refer to Wall Control specification sheet for more information.

Core

Polypropylene crossflow core, impact resistant
 Dimensions: 12" x 12" x 9" (30.5 cm x 30.5 cm x 23 cm)

Filters

- MERV 8 grade washable standard filter (included)
- Optional MERV 13 grade filter part no. V242851


Options

 Compatible with Tandem Terminations (part no. VTYIK1 and V14695) (CFM output must meet application requirements)

¹Airflow performances associated with MERV 13 optional filter are not HVI certified. However, from tests performed by the manufacturer, such performances are not affected by the use of this filter.

6" Ports Dimensions (Top Ports)


Total assembled weight: approx 35 lbs (15.9 kg) (core included) Shipping weight: approx 42 lbs (19 kg)

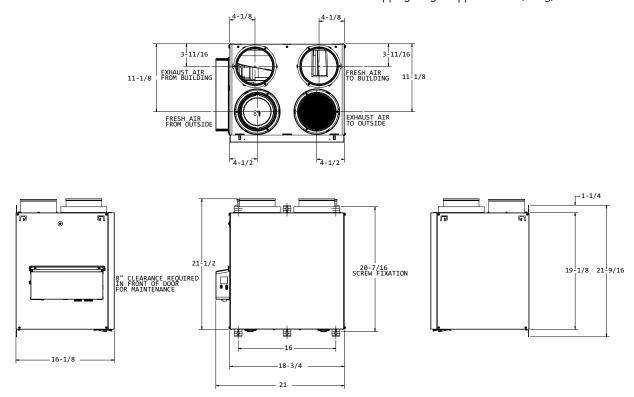

Dimensions shown in inches

6" Ports Dimensions (Side Ports)

Total assembled weight: approx 35 lbs (15.9 kg) (core included) Shipping weight: approx 42 lbs (19 kg)

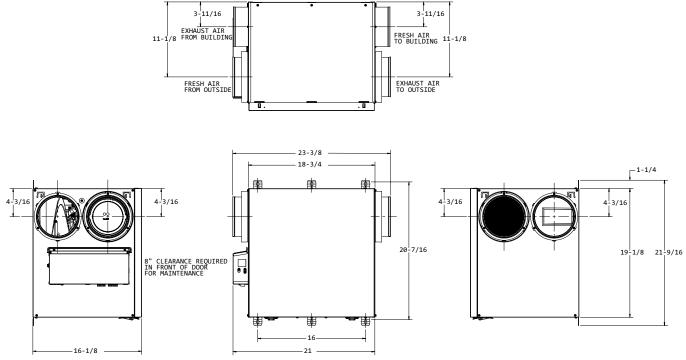


VK0127

VK0128

Defrost System

Homeshield™ Defrosting System
Defrost is activated at a
temperature of 23°F and lower
as specified within the table. No
negative pressure is created by
air exhausted to the outdoors
since the air is recirculated into
the house, helping to prevent any
backdraft.



Outdoor Temperature*					
-5°С то -15°С 23°F то 5°F		-15°С то -27°С 5°F то -17°F		-27°C AND LESS -17°F AND LESS	
AIR EXCHANGE IN MINUTES	DEFROST IN MINUTES	AIR EXCHANGE IN MINUTES	DEFROST IN MINUTES	AIR EXCHANGE IN MINUTES	DEFROST IN MINUTES
36	8	25	8	21	10
50	8	32	8	25	10
27	8	20	8	17	10
	23°F TO 5°F AIR EXCHANGE IN MINUTES 36 50 27	-5°C TO -15°C 23°F TO 5°F AIR EXCHANGE DEFROST IN MINUTES N MINUTES 36 8 50 8 27 8	-5°C TO -15°C -15°C TO -27 23°F TO 5°F 5°F TO -17°C AIR EXCHANGE IN MINUTES IN MINUTES IN MINUTES 36 8 25 50 8 32 27 8 20	-5°C TO -15°C -15°C TO -27°C 23°F TO 5°F 5°F TO -17°F AIR EXCHANGE IN MINUTES	-5°C TO -15°C

^{*}Outdoor temperature is read by a thermistor located inside the unit, next to fresh air from outdoor port.

PLUS	Outdoor Temperature*					
	-5°С то -15° 23°F то 5°F	С	-15°С то -27°С 5°F то -17°F		-27°C AND LESS -17°F AND LESS	
CFM	AIR EXCHANGE IN MINUTES	DEFROST IN MINUTES	AIR EXCHANGE IN MINUTES	DEFROST IN MINUTES	AIR EXCHANGE IN MINUTES	DEFROST IN MINUTES
0 to 59	28	8	21	8	15	10
60 to 90	38	8	27	8	18	10
91 and more	20	8	16	8	12	10


^{*}Outdoor temperature is read by a thermistor located inside the unit, next to fresh air from outdoor port.

Fan Curves with Virtuo

Thanks to Virtuo Air Technology™, no need to balance the unit manually. Both PMSM motors are controlled by an artificial intelligence performing 120 readings per minute then processing this information to maintain the requested airflow.

For typical installation, Virtuo will ensure a balanced ventilation at every selected speed regardless of the weather conditions, the type of connection, the variable speed furnace/AHU, the stack effect, the filter clogging and so on. This results in peace of mind for installers and users knowing that the unit will always remain balanced and that it will maintain its maximum heat/energy recovery efficiency.

STATIC PRESSURE (PA)	1.0Static Pressure (in. w.g.)	NET SUPPLY AIRFLOW (L/s)	NET SUPPLY AIRFLOW (CFM)	Gross Airflow Supply (L/s)	Gross Airflow Supply (cfm)	Gross Airflow Exhaust (L/s)	Gross Airflow Exhaust (cfm)
25	0.1	77	163	78	165	78	165
50	0.2	75	159	76	161	76	161
75	0.3	73	155	74	157	74	157
100	0.4	71	150	72	153	72	153
125	0.5	68	144	69	146	69	146
150	0.6	66	140	67	142	67	142
175	0.7	63	133	64	136	64	136
200	0.8	60	127	61	129	61	129
225	0.9	57	121	58	123	58	123
250	1.0	54	114	55	117	55	117

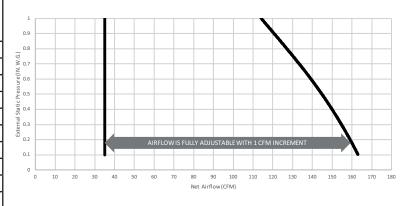

Energy Performance

SUPPLY	rature	Net A	IRFLOW	Power Consumed	Sensible Recovery Efficiency	Adjusted Sensible Recovery Efficiency	Apparent Sensible Effectiveness*
°C	°F	L/S	CFM	WATTS			
HEATI	NG						
0	32	17	36	18	82%	85%	88%
0	32	22	47	22	79%	82%	85%
0	32	30	64	28	77%	80%	82%
0	32	61	129	100	66%	71%	72%
-25	-13	31	66	43	67%	69%	80%

^{*}Data not certified by HVI.

Requirements and Standards

- UL 1812 compliant (safety)
- Performance tested in accordance with CSA C439 Standard
- Compliant with Prop 65

- Can be used to comply with California Title 24 2019 Part 6 Fault Indicator Display Requirements
- Can be used to earn WA energy code credits

Project:		Remarks
Location:		
Part no.:		
Qty.:		
Submitted by:	Date:	



